



# County of Yuba

Community Development and Services Department


Building Division

915 8th Street, Suite 123  
Marysville, Ca 95901

PHONE : (530) 749-5440

FAX: (530) 749-5434

www.co.yuba.ca.us

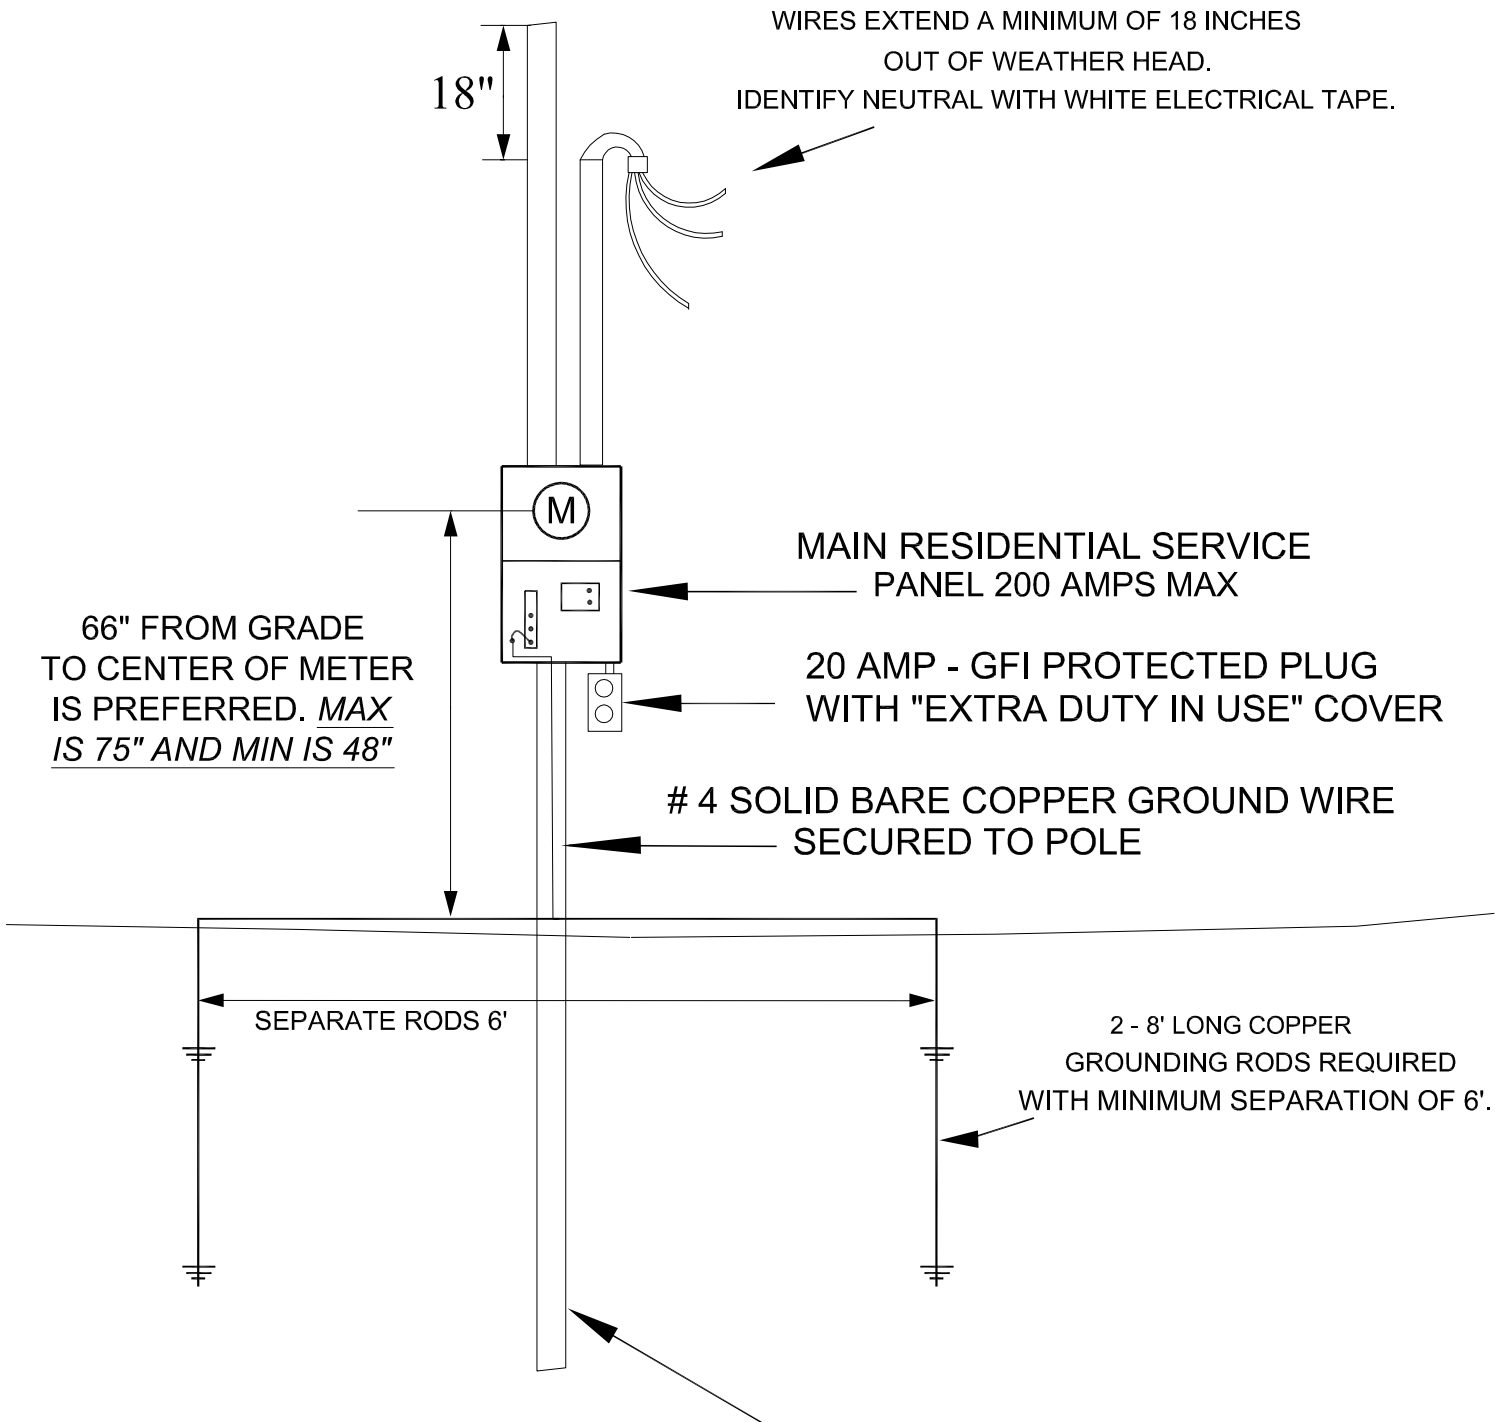

25' OR 30' TALL PG&E APPROVED POWER POLE INSTALLED PER PG&E REGULATIONS  
PLACE POLE IN GROUND 5 FOOT.

POLES ARE AVAILABLE AT MOST ELECTRICAL SUPPLY FACILITIES.



# County of Yuba

Community Development and Services Agency

Building Department

915 8th Street, Suite 123  
Marysville, Ca 95901


PHONE : (530) 749-5440

FAX: (530) 749-5616

www.co.yuba.ca.us

## ELECTRICAL SERVICE PANEL GROUNDING

Electrodes shall be installed so  
at least 8 feet of length is in contact with the soil.

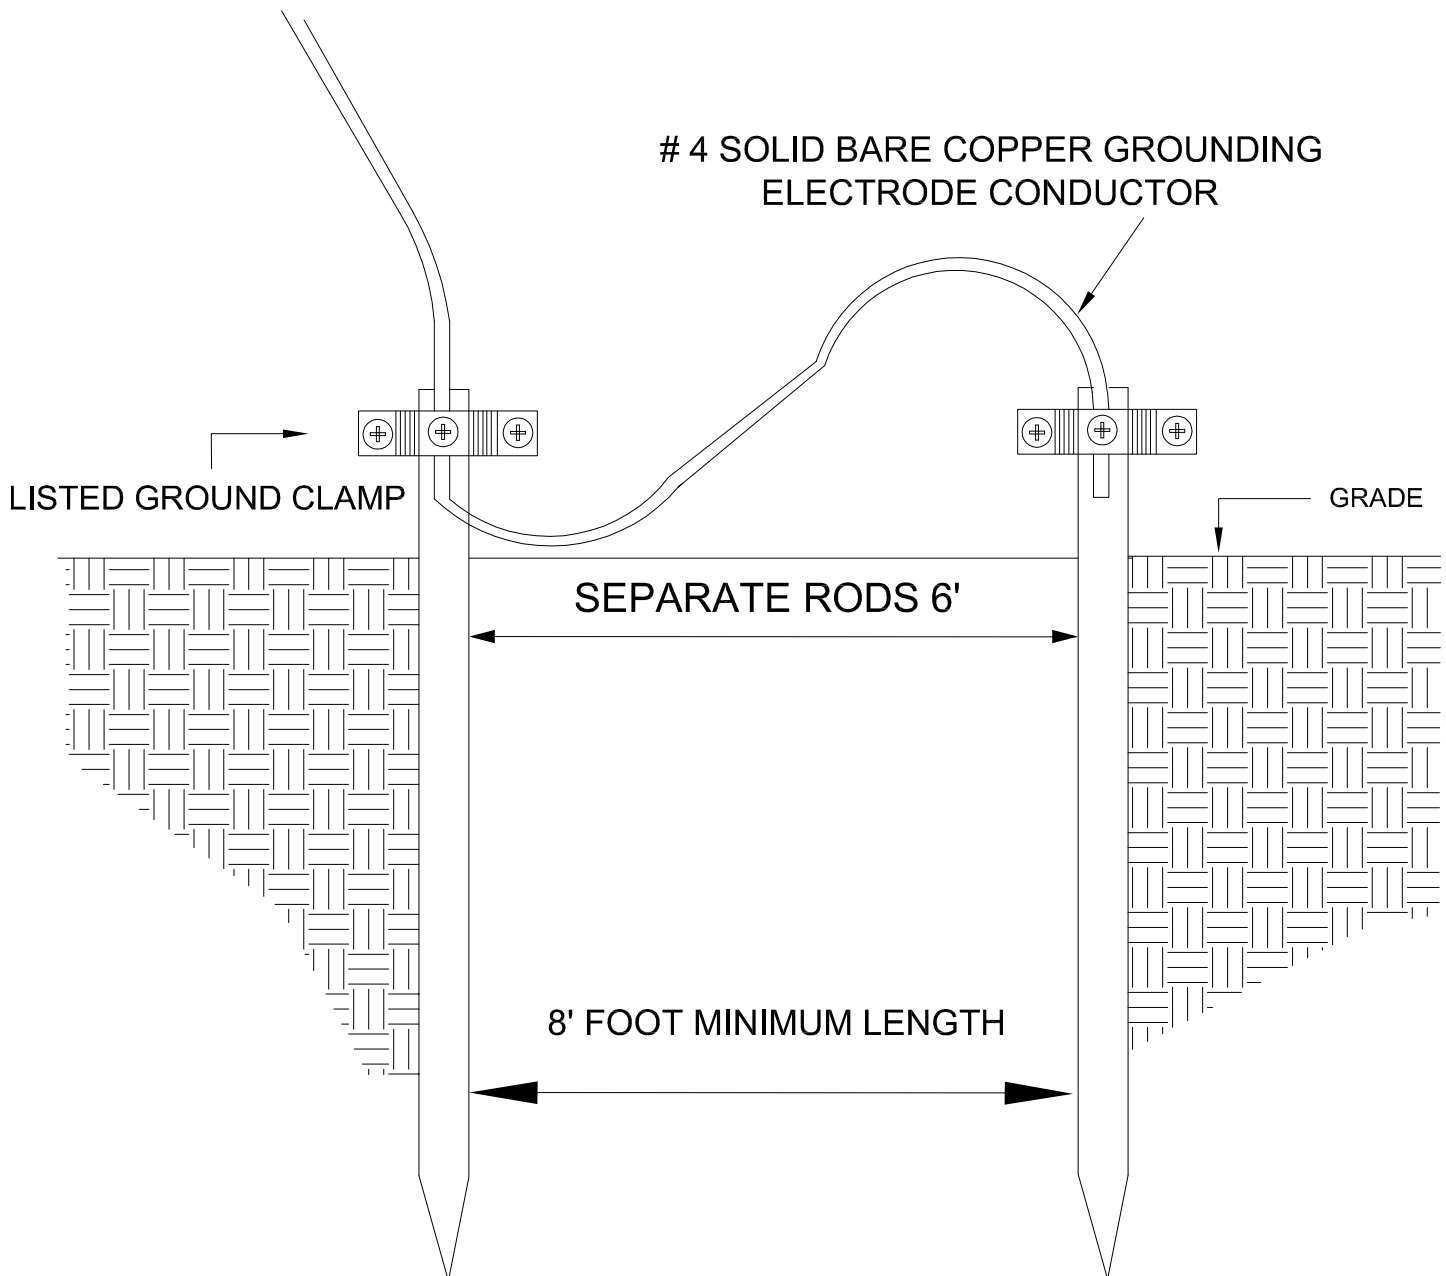



# County of Yuba

Community Development and Services Agency

Building Department

915 8th Street, Suite 123  
Marysville, Ca 95901

PHONE : (530) 749-5440

FAX: (530) 749-5434

www.co.yuba.ca.us

## Residential Underground Utilities Installations

California codes specify minimum depth and cover requirements for underground gas piping, water piping, electrical conduits and conductors rated for direct burial.

**NOTE: THE CALIFORNIA ELECTRICAL CODE REQUIRES WARNING RIBBON TO BE INSTALLED 12" ABOVE UNDERGROUND CONDUIT AND CONDUCTORS**

CALIFORNIA PLUMBING CODE	WATER PIPING	12" MINIMUM COVER
CALIFORNIA PLUMBING CODE	PLASTIC GAS PIPING	18" MINIMUM COVER
	METALLIC GAS PIPING	12" MINIMUM COVER
CALIFORNIA ELECTRIC CODE	UNDERGROUND NONMETALLIC CONDUIT	18" MINIMUM COVER
	DIRECT BURIAL CABLE	24" MINIMUM COVER

MINIMUM DEPTH / COVER REQUIREMENTS ARE AS FOLLOWS  
AND ARE MEASURED FROM TOP OF CONDUIT / PIPE

